


2025 LARGE DIAMETER SEWER REHAB ROGERS, AR



VICINITY MAP
SCALE: NTS

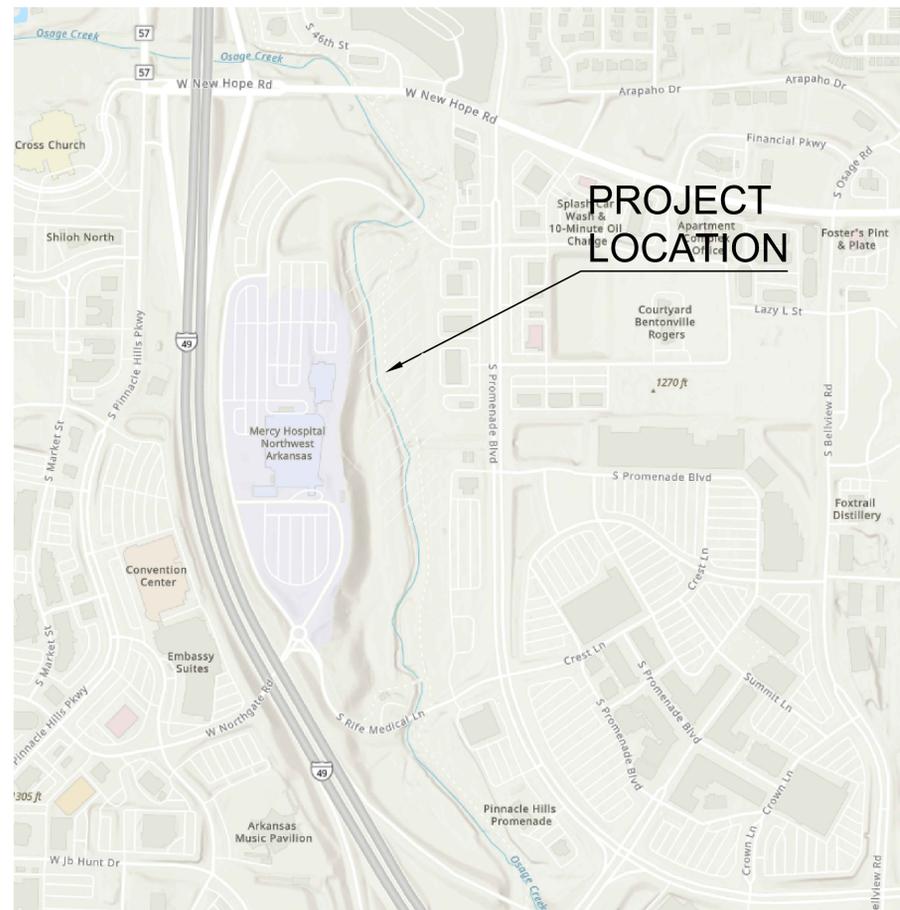

SHEET INDEX

1. PHASING PLAN
2. DEMOLITION PLAN
3. SEWER LINE 1 STA 0+00 TO STA 1+67
4. SEWER LINE 2 STA 0+00 TO STA 3+64
5. SEWER LINE 3 STA 0+00 TO STA 7+12
6. SEWER LINE 4 STA 0+00 TO STA 0+45
7. SEWER LINE 5 STA 0+00 TO STA 0+53
8. SEWER LINE 6 STA 0+00 TO STA 0+44
9. DIVERSION BOX DETAIL
10. SD-1 SEWER DETAILS



Call before you Dig
www.callbeforeyoudig.com
800.481.4811



P.O. DRAWER 338
OFFICE - 601 SOUTH 2ND ROGERS, ARKANSAS
72757-0338

2025 LARGE DIAMETER SEWER REHAB


PHASING PLAN

- NOTES:
1. THIS PLAN DOES NOT PROPORT TO SHOW THE LOCATIONS OF ALL UNDERGROUND UTILITIES AS PRECISE OR COMPLETE. THE CONTRACTOR SHALL VERIFY DEPTHS & LOCATIONS OF UNDERGROUND UTILITIES PRIOR TO CONSTRUCTION.
 2. LOCATIONS OF SERVICE CROSSINGS ARE SUBJECT TO FIELD CHANGES BY ROGERS WATER UTILITIES
 3. THE CONTRACTOR SHALL ADHERE TO ALL RWU STANDARD DETAILS AND SPECIFICATIONS (LATEST EDITION) FOR WORK PERFORMED ON WATER & SEWER UTILITIES.
 4. COORDINATE WITH THE ROGERS STREET DEPT. FOR STREET REPAIR AND STORM SEWER IMPROVEMENTS.
 5. COORDINATE THE DIVERSION OF SANITARY SEWER FLOW WITH RWU PERSONNEL

LEGEND

EXISTING	PROPOSED
8" W	8" W WATER MAIN
8" SS	8" SS SEWER MAIN
24" SS	24" SS SEWER MAIN TO ABANDON
UG/T	UG/T UNDERGROUND TELEPHONE
UG/E	UG/E UNDERGROUND ELECTRIC
OH/E	OH/E OVERHEAD ELECTRIC
GAS	GAS MAIN
X	WIRE FENCE
o	CHAIN LINK FENCE
o	WOOD FENCE
o	GAS METER
o	WATER METER
o	FIRE HYDRANT
o	WATER VALVE
o	AIR RELEASE
o	MANHOLE
o	POWER POLE
o	POWER POLE W/ GUY
o	CONTROL POINT
o	FOUND IRON PIN/PIPE
o	SIGN
o	PAVING REPAIR


Revisions



Drawn by: CSB
 Checked by: ABS

Job Number: JOBNO
 Contact Person: TRAVIS TRIPODI

Date: 01/20/2026
 Sheet Number: 1

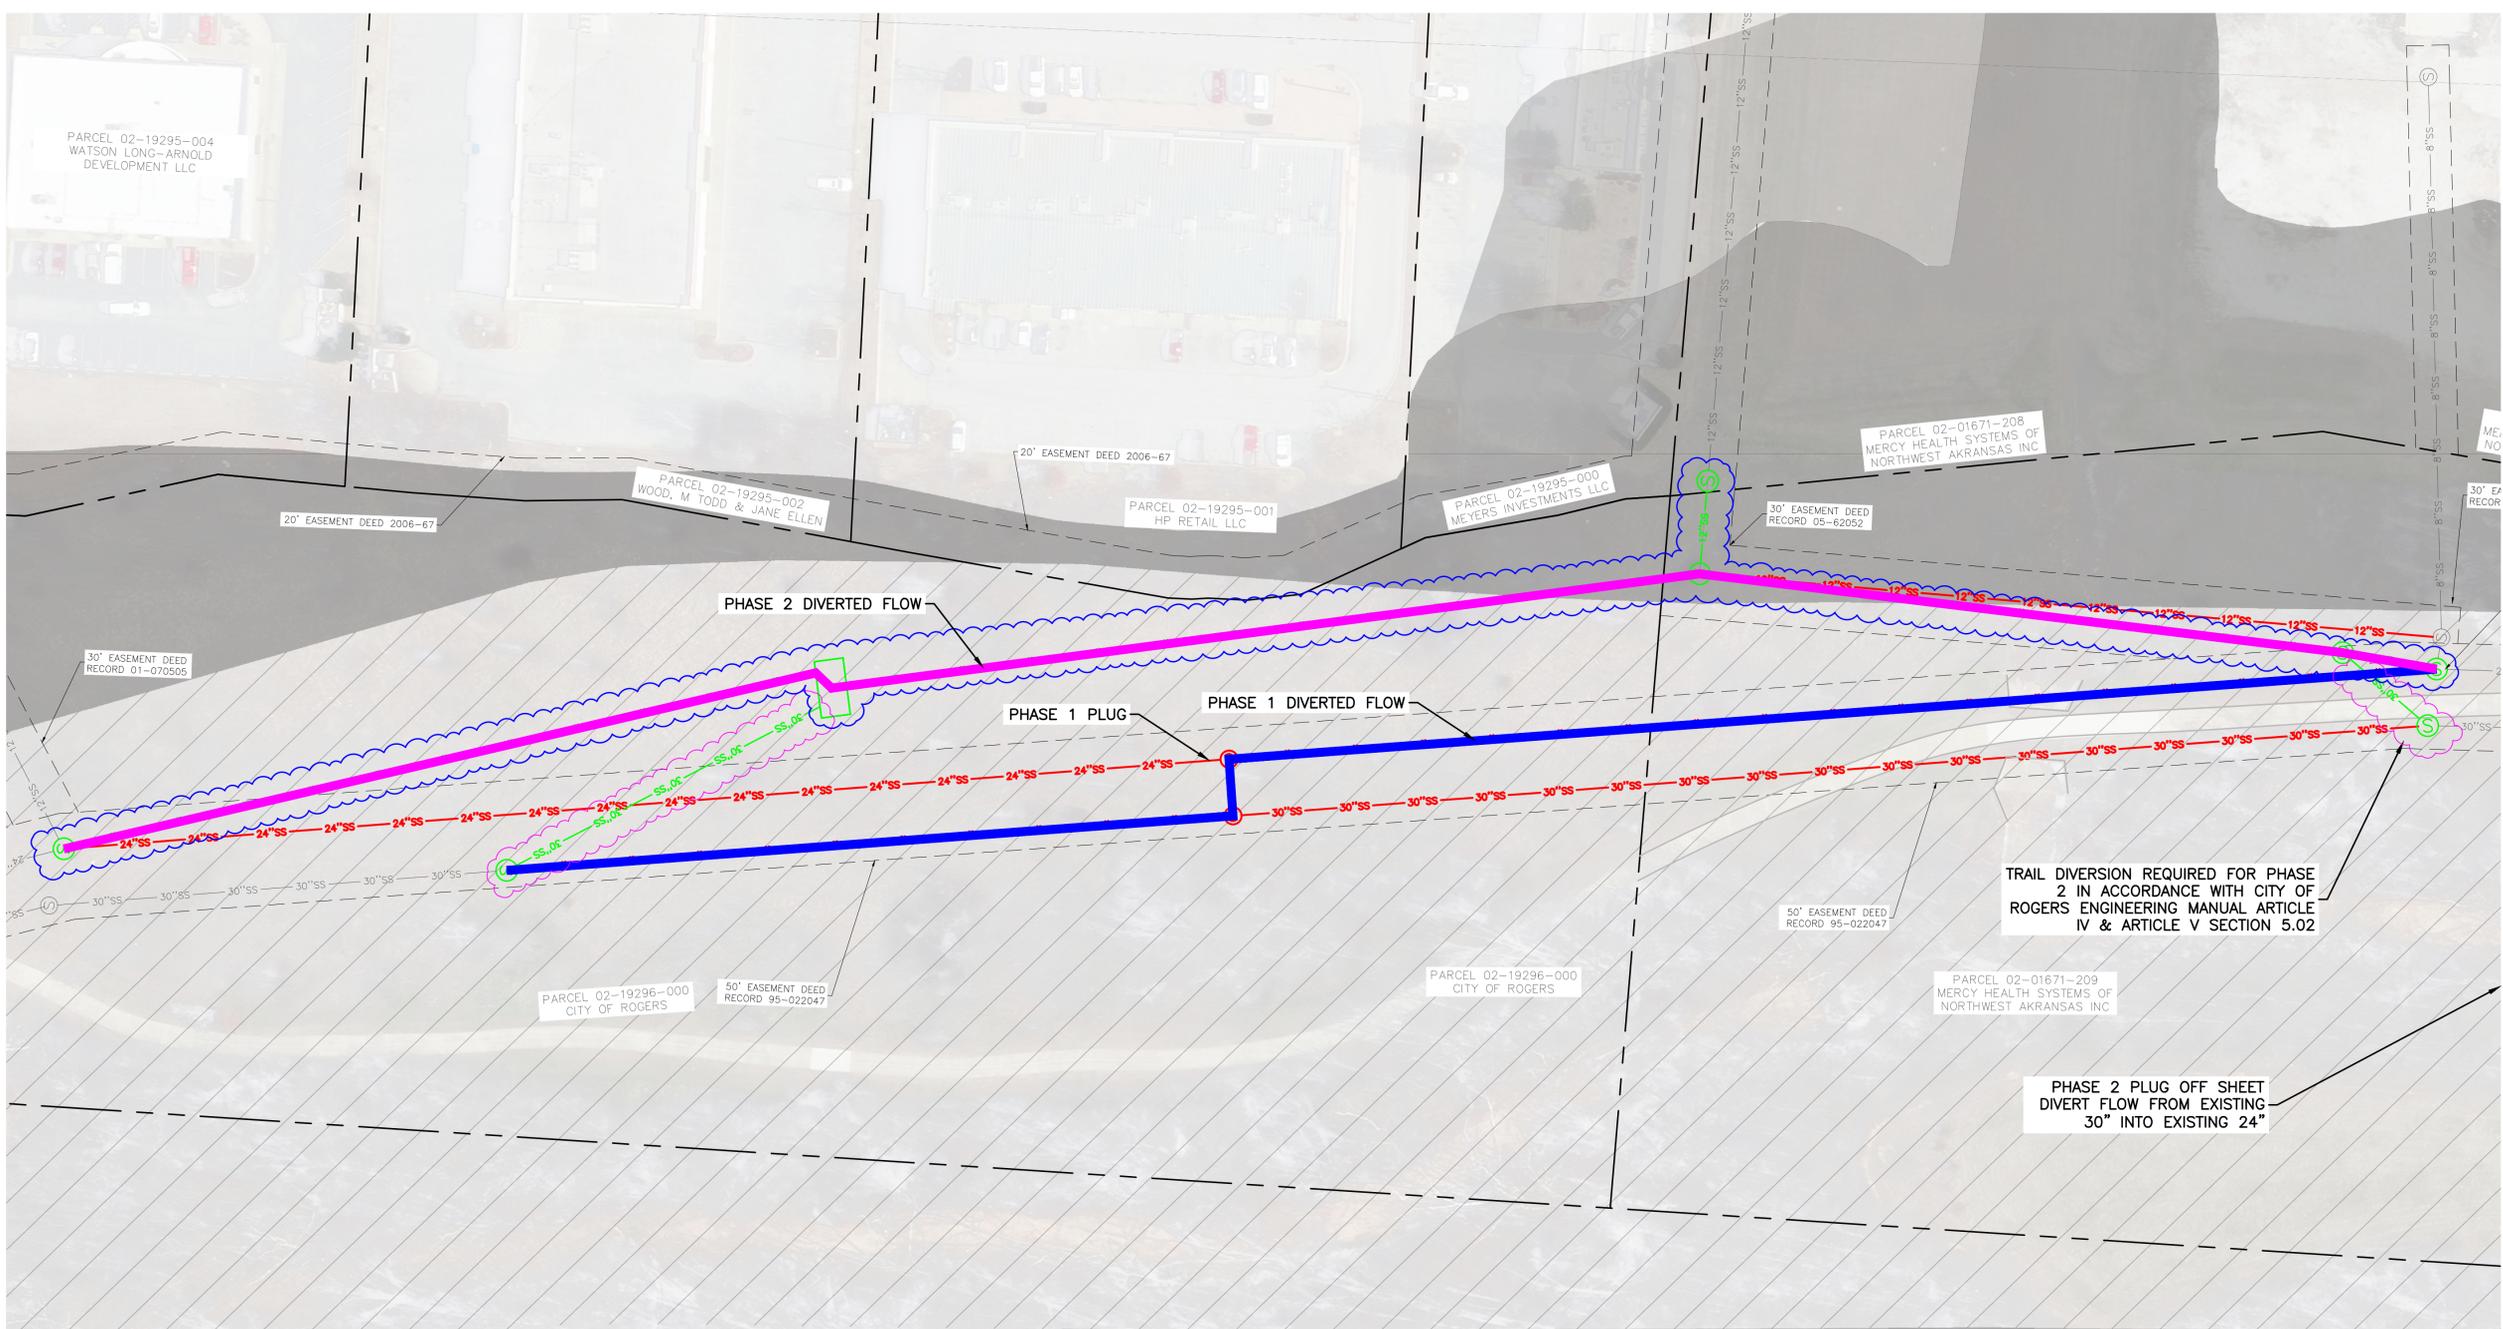


FLOOD HAZARD AREAS

- ZONE AE FLOODWAY
- ZONE AE
- ZONE X

PHASING PLAN

- PHASE 1
- PHASE 2

PHASING PLAN
 SCALE: 1"=40'



Call 811
 Call before you Dig
 Avoid cutting underground utility lines. It's costly.

2025 LARGE DIAMETER SEWER REHAB

DEMOLITION PLAN

- NOTES:
- THIS PLAN DOES NOT PROPORT TO SHOW THE LOCATIONS OF ALL UNDERGROUND UTILITIES AS PRECISE OR COMPLETE. THE CONTRACTOR SHALL VERIFY DEPTHS & LOCATIONS OF UNDERGROUND UTILITIES PRIOR TO CONSTRUCTION.
 - LOCATIONS OF SERVICE CROSSINGS ARE SUBJECT TO FIELD CHANGES BY ROGERS WATER UTILITIES.
 - THE CONTRACTOR SHALL ADHERE TO ALL RWU STANDARD DETAILS AND SPECIFICATIONS (LATEST EDITION) FOR WORK PERFORMED ON WATER & SEWER UTILITIES.
 - COORDINATE WITH THE ROGERS STREET DEPT. FOR STREET REPAIR AND STORM SEWER IMPROVEMENTS.
 - DISTURBED LAND WILL BE RESTABILIZED AND REVEGETATED WITH SOO WITHIN 14 DAYS OF WORK CEASING IN ACCORDANCE WITH ADEO BEST MANAGEMENT PRACTICES.

LEGEND

EXISTING	PROPOSED
8" W	8" W WATER MAIN
8" SS	8" SS SEWER MAIN
24" SS	24" SS SEWER MAIN TO ABANDON
UO/T	UNDERGROUND TELEPHONE
UO/E	UNDERGROUND ELECTRIC
OH/E	OVERHEAD ELECTRIC
GS	GAS MAIN
X	WIRE FENCE
o	CHAIN LINK FENCE
o	WOOD FENCE
o	GAS METER
o	WATER METER
o	FIRE HYDRANT
o	WATER VALVE
o	AIR RELEASE
o	MANHOLE
o	POWER POLE
o	POWER POLE W/ GUY
o	CONTROL POINT
o	FOUND IRON PIN/PIPE
o	SIGN
o	PAVING REPAIR


Revisions



Drawn by: CSB
 Checked by: ABS


Job Number: JOBNO
 Contact Person: TRAVIS TRIPODI

Date: 01/20/2026
 Sheet Number: 2

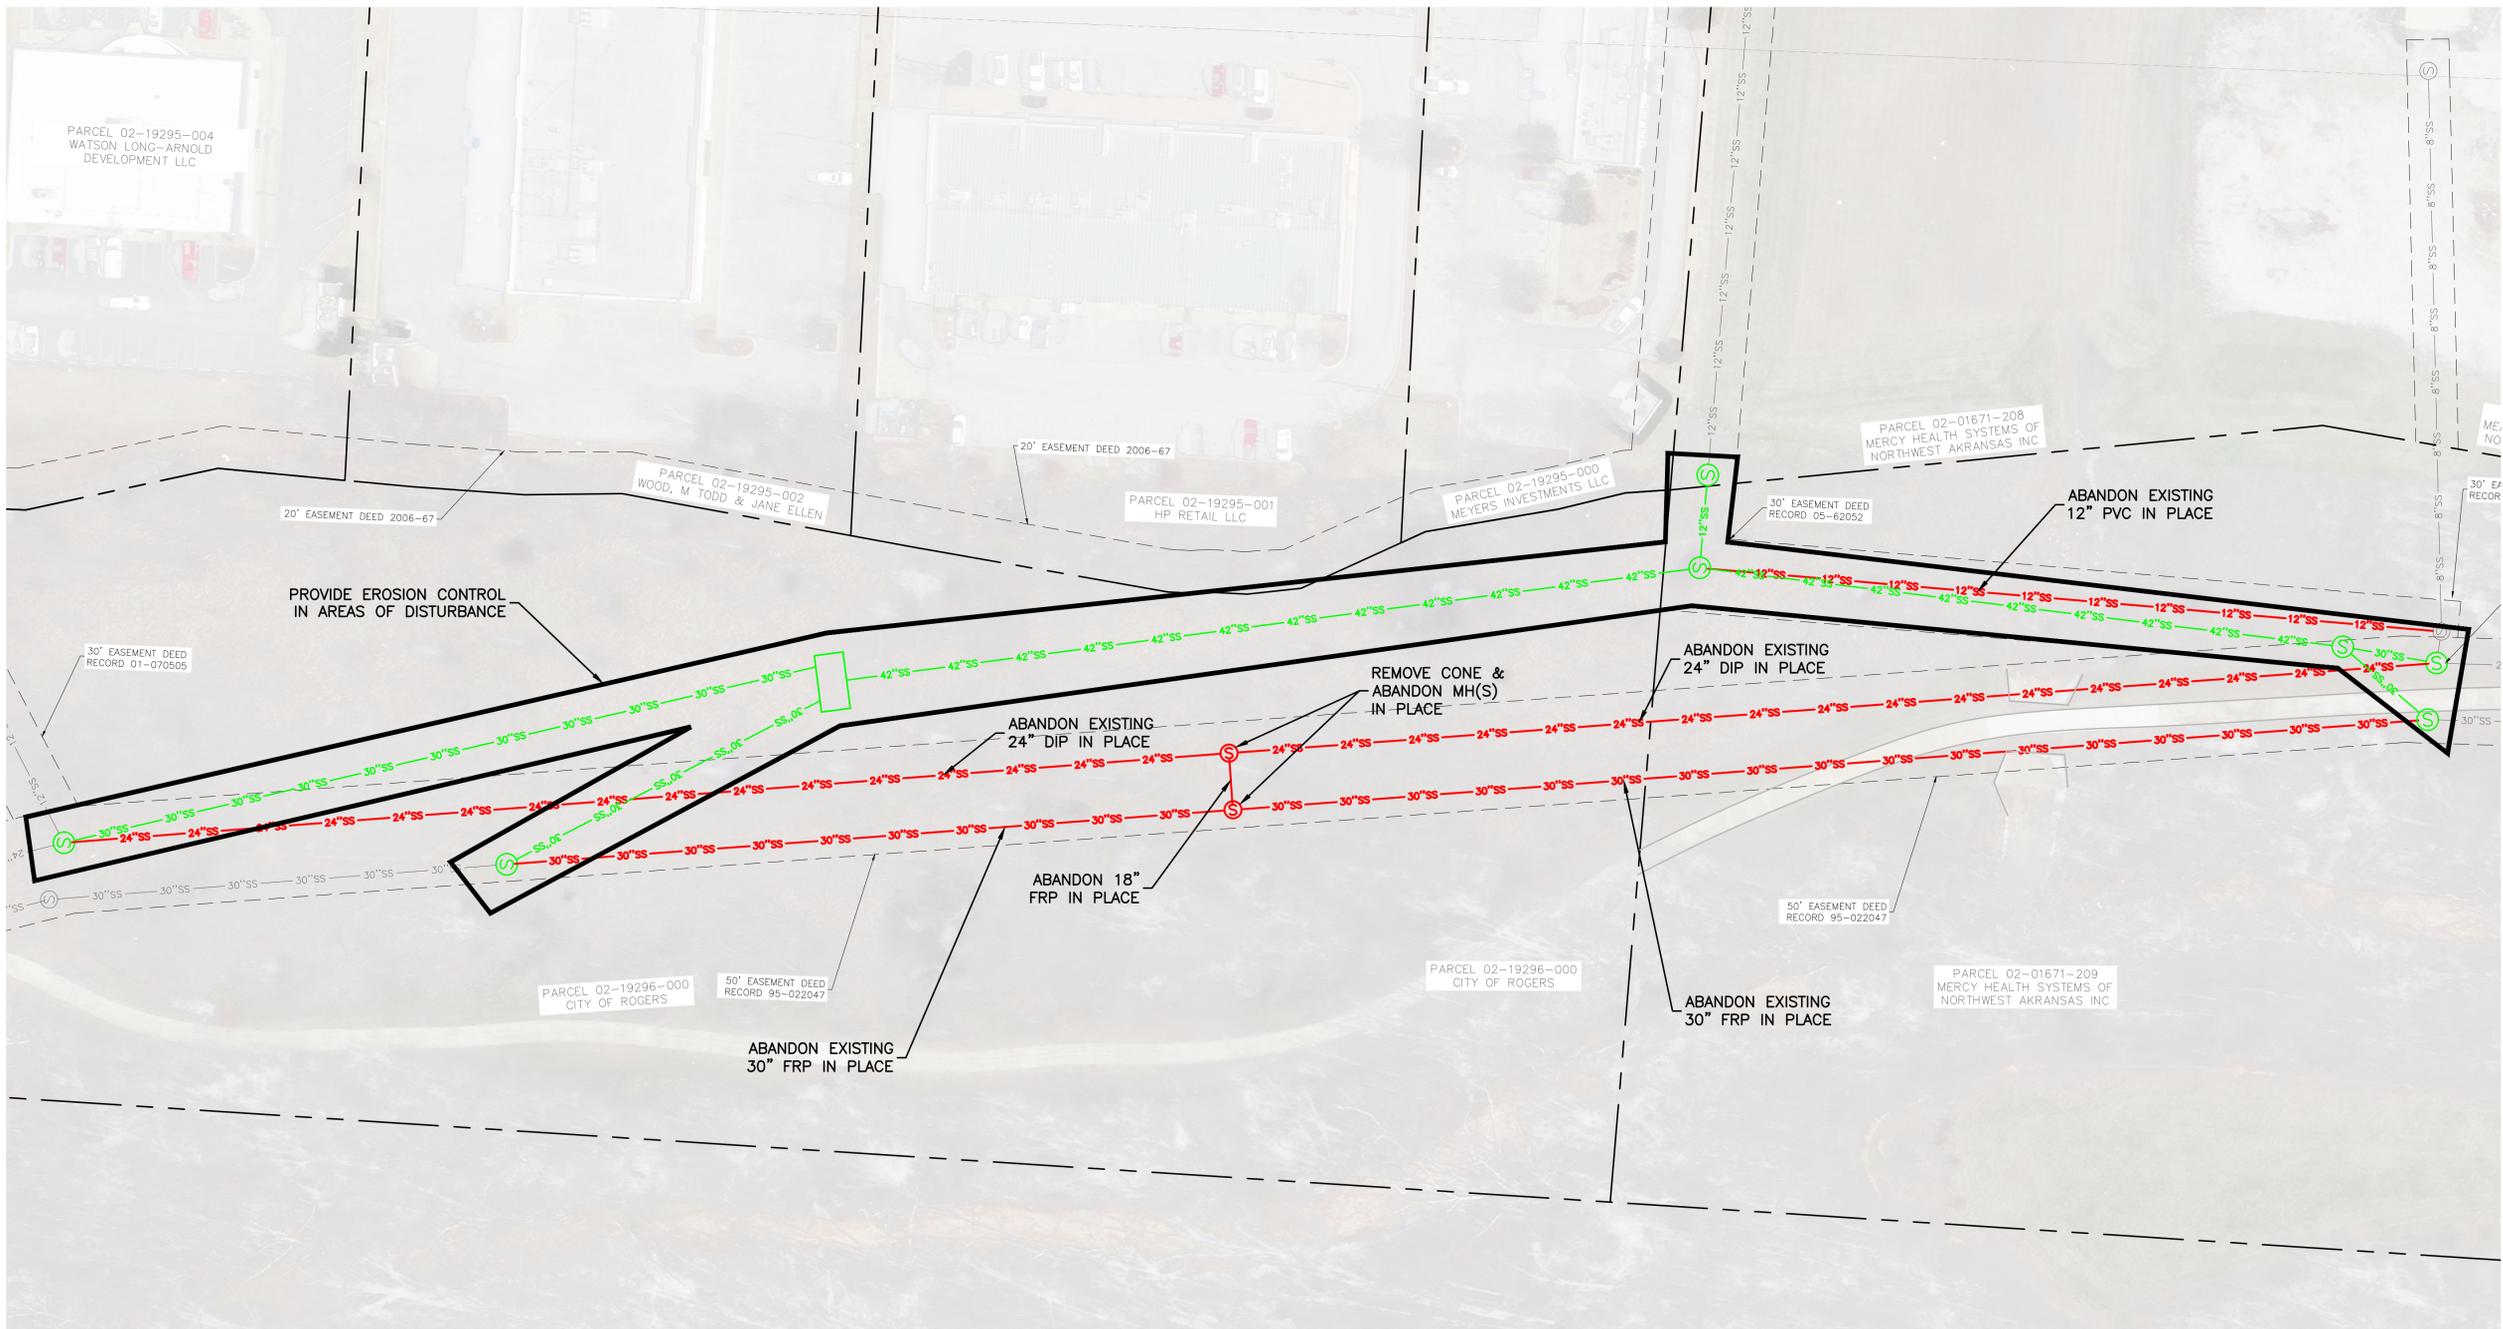


- NOTES:
- DISTURBED LAND WILL BE RESTABILIZED AND REVEGETATED WITH SOO WITHIN 14 DAYS OF WORK CEASING IN ACCORDANCE WITH ADEO BEST MANAGEMENT PRACTICES.


DEMOLITION PLAN
 SCALE: 1"=40'




Call **811**
 Call before you Dig
 Avoid cutting underground utility lines. It's costly.

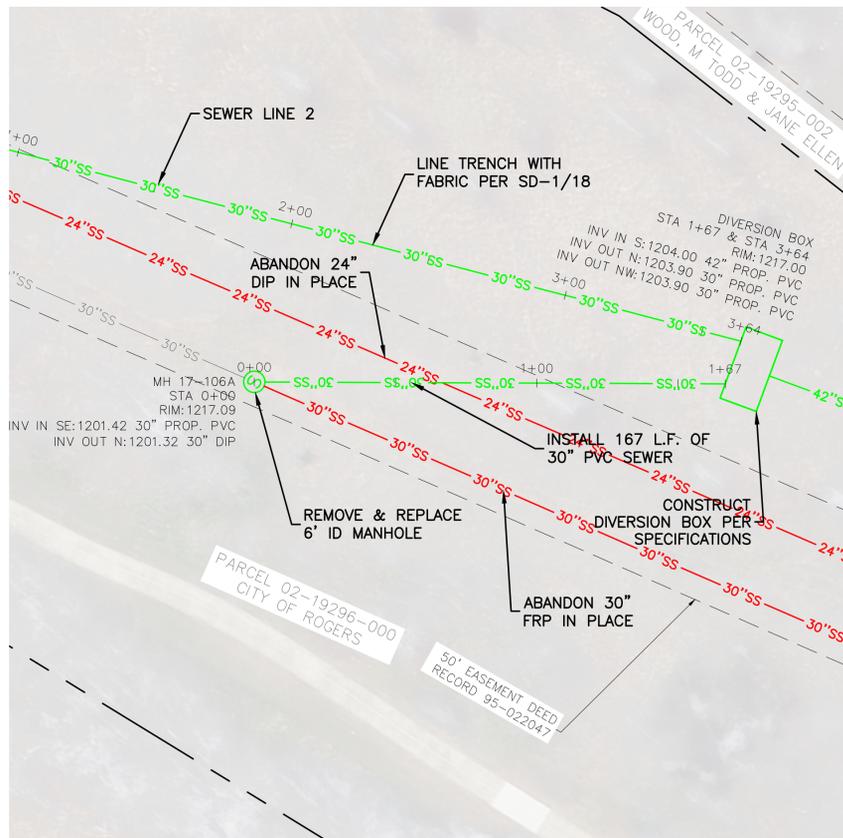


SEWER LINE 1 STA 0+00 TO 1+67
SCALE: 1"=30'

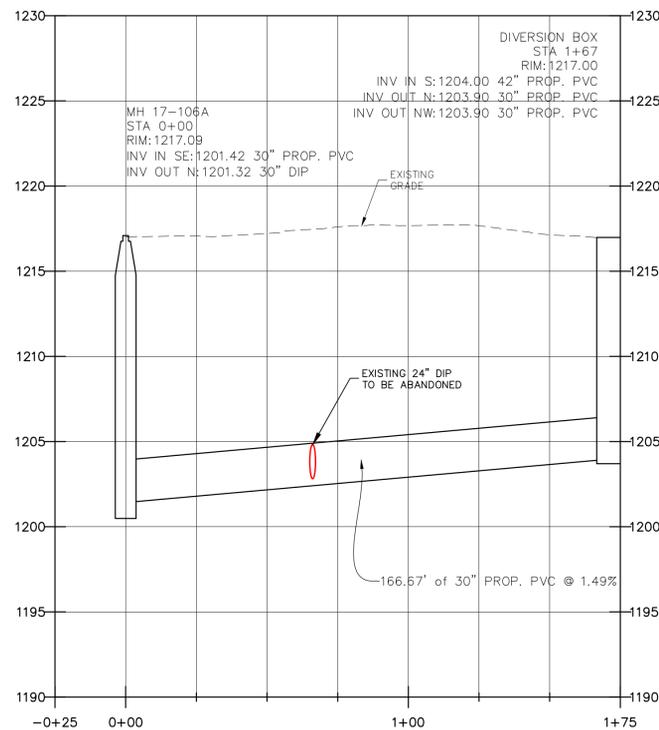

SEWER LINE 1 0+00 TO 1+67
SCALE: HORIZ: 1"=30' / VERT: 1"=5'

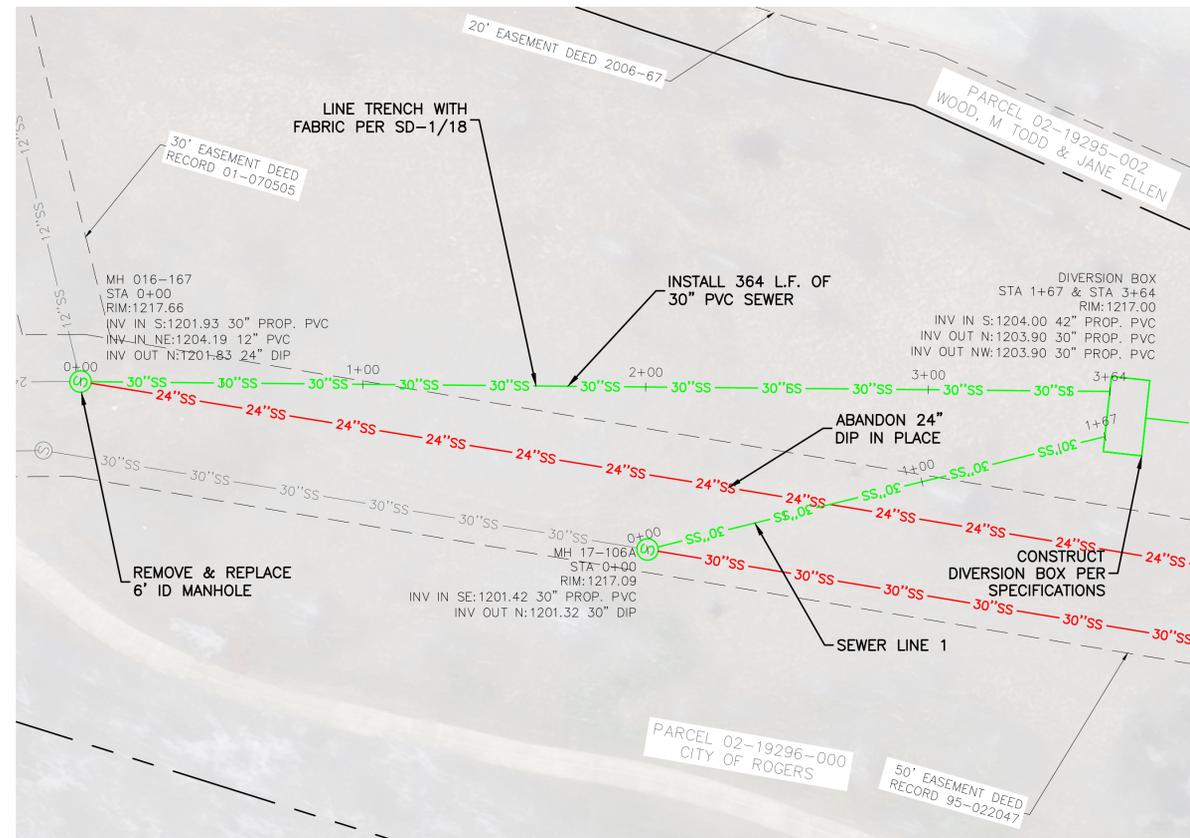

SEWER LINE 2 STA 0+00 TO 3+64
SCALE: 1"=30'

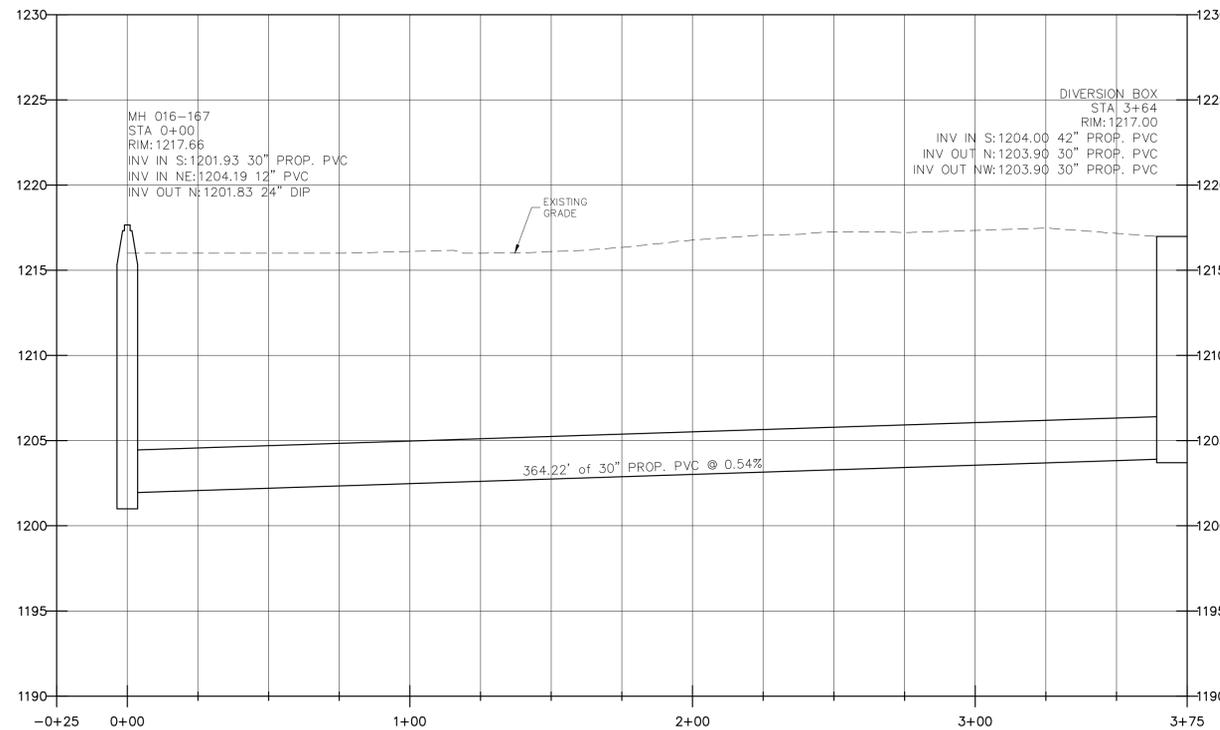

SEWER LINE 2 STA 0+00 TO 3+64
SCALE: HORIZ: 1"=30' / VERT: 1"=5'

RWU ROGERS WATER UTILITIES
P.O. DRAWER 338
OFFICE - 601 SOUTH 2ND ST. ROGERS, ARKANSAS
72757-0338

PROJECT LOCATION

VICINITY MAP
N.T.S.

2025 LARGE DIAMETER SEWER REHAB


SEWER LINE 1
STA 0+00 TO STA 1+67
SEWER LINE 2
STA 0+00 TO STA 3+64

- NOTES:
- THIS PLAN DOES NOT PROPOR TO SHOW THE LOCATIONS OF ALL UNDERGROUND UTILITIES AS PRECISE OR COMPLETE. THE CONTRACTOR SHALL VERIFY DEPTHS & LOCATIONS OF UNDERGROUND UTILITIES PRIOR TO CONSTRUCTION.
 - LOCATIONS OF SERVICE CROSSINGS ARE SUBJECT TO FIELD CHANGES BY ROGERS WATER UTILITIES
 - THE CONTRACTOR SHALL ADHERE TO ALL RWU STANDARD DETAILS AND SPECIFICATIONS (LATEST EDITION) FOR WORK PERFORMED ON WATER & SEWER UTILITIES.
 - COORDINATE WITH THE ROGERS STREET DEPT. FOR STREET REPAIR AND STORM SEWER IMPROVEMENTS.

LEGEND

EXISTING	PROPOSED
8" W	8" W WATER MAIN
8" SS	8" SS SEWER MAIN
24" SS	24" SS SEWER MAIN TO ABANDON
UG/T	UG/T UNDERGROUND TELEPHONE
UG/E	UG/E UNDERGROUND ELECTRIC
OH/E	OH/E OVERHEAD ELECTRIC
GS	GS GAS MAIN
X	X WIRE FENCE
o	o CHAIN LINK FENCE
o	o WOOD FENCE
o	o GAS METER
o	o WATER METER
o	o FIRE HYDRANT
o	o WATER VALVE
o	o AIR RELEASE
o	o MANHOLE
o	o POWER POLE
o	o POWER POLE W/ GUY
o	o CONTROL POINT
o	o FOUND IRON PIN/PIPE
o	o SIGN
o	o PAVING REPAIR

Revisions




Drawn by: CSB
Checked by: ABS


Job Number: JOBNO
Contact Person: TRAVIS TRIPODI

Date: 01/20/2026
Sheet Number: 3




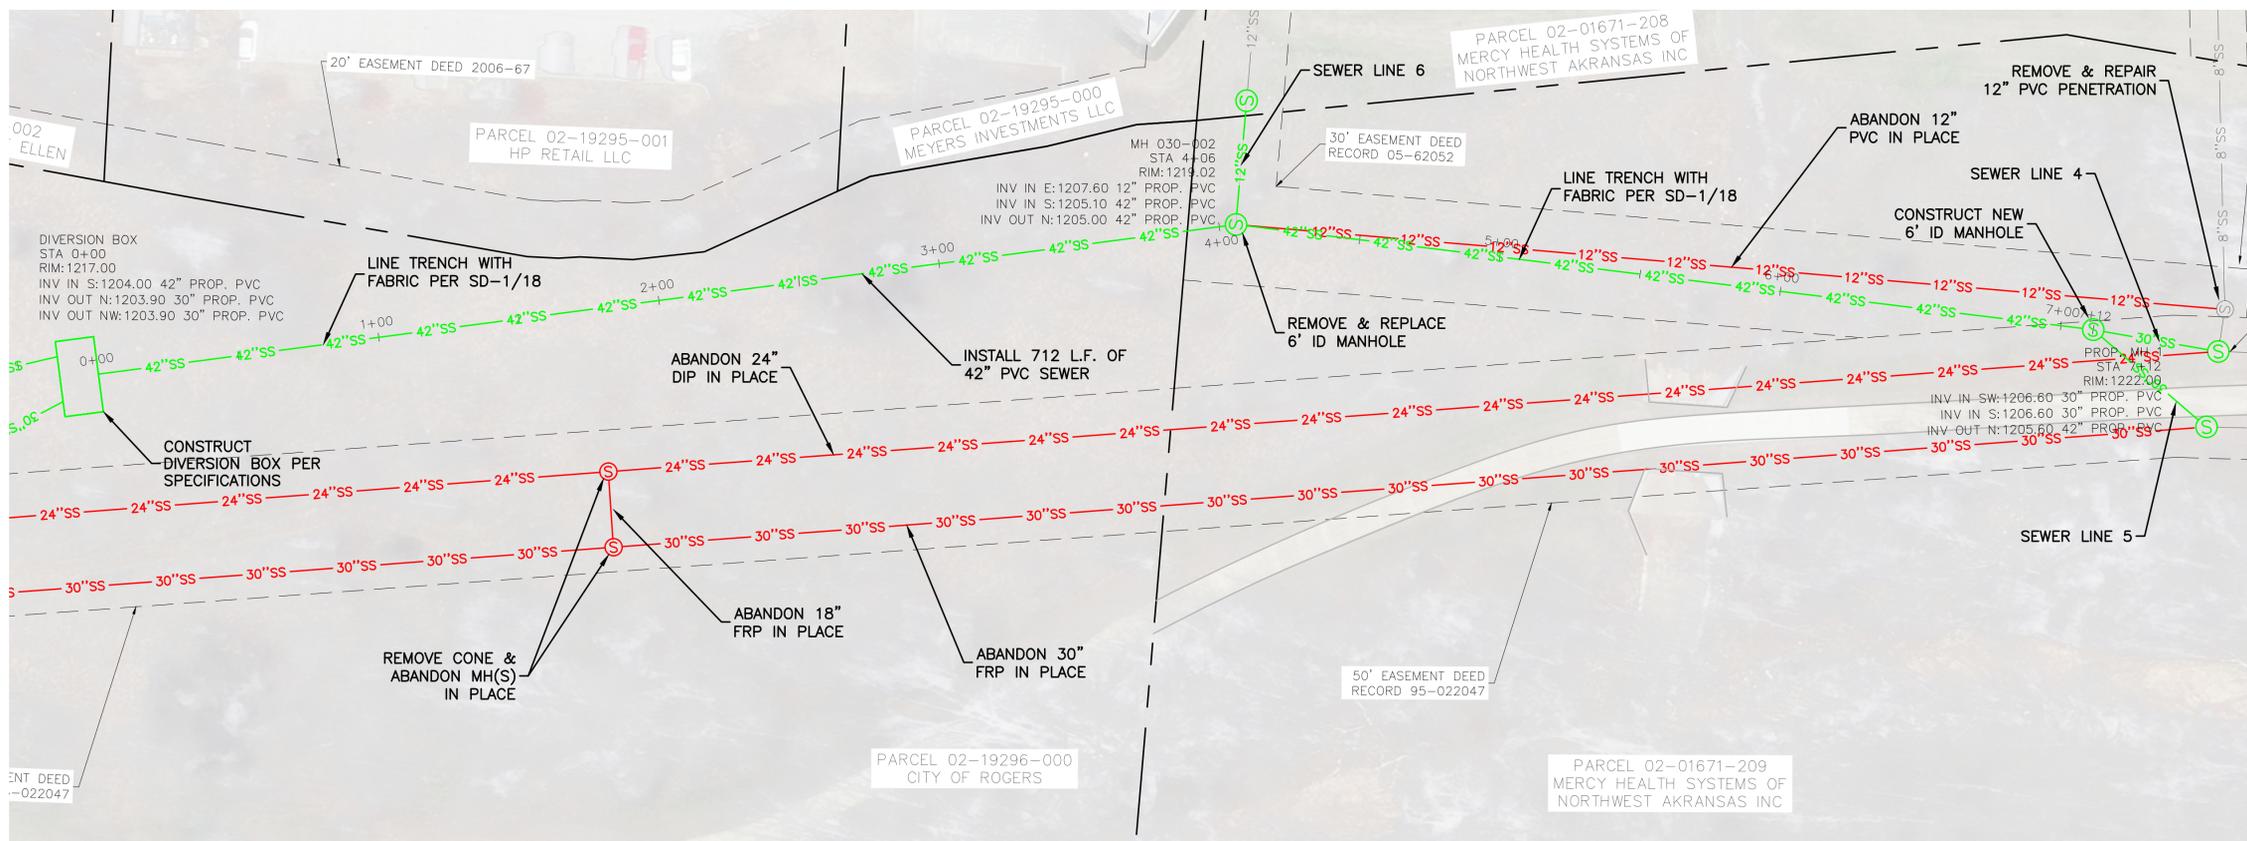

SEWER LINE 3 STA 0+00 TO 7+12
SCALE: 1"=30'

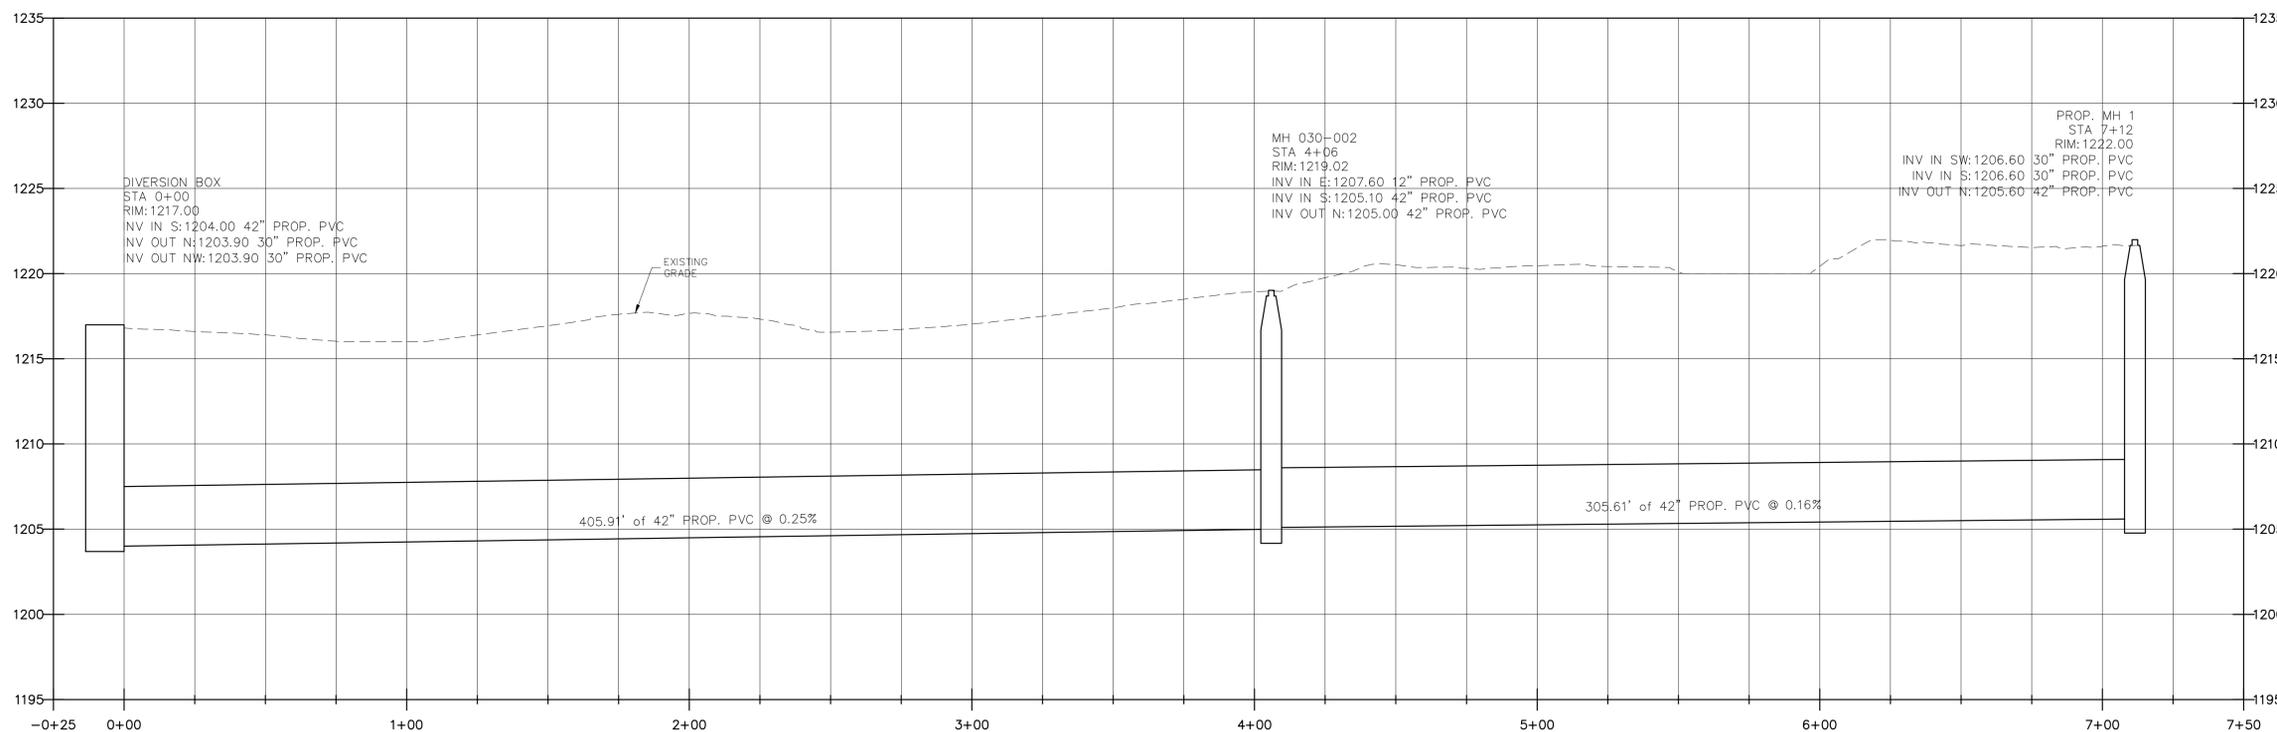

SEWER LINE 3 STA 0+00 TO 7+12
SCALE: HORIZ: 1"=30' / VERT: 1"=5'



RWU ROGERS WATER UTILITIES
P.O. DRAWER 338
OFFICE - 601 SOUTH 2ND ST. ROGERS, ARKANSAS
72757-0338

PROJECT LOCATION

VICINITY MAP
N.T.S.

2025 LARGE DIAMETER SEWER REHAB


SEWER LINE 3
STA 0+00 TO STA 7+12

- NOTES:
1. THIS PLAN DOES NOT PROPORT TO SHOW THE LOCATIONS OF ALL UNDERGROUND UTILITIES AS PRECISE OR COMPLETE. THE CONTRACTOR SHALL VERIFY DEPTHS & LOCATIONS OF UNDERGROUND UTILITIES PRIOR TO CONSTRUCTION.
 2. LOCATIONS OF SERVICE CROSSINGS ARE SUBJECT TO FIELD CHANGES BY ROGERS WATER UTILITIES
 3. THE CONTRACTOR SHALL ADHERE TO ALL RWU STANDARD DETAILS AND SPECIFICATIONS (LATEST EDITION) FOR WORK PERFORMED ON WATER & SEWER UTILITIES.
 4. COORDINATE WITH THE ROGERS STREET DEPT. FOR STREET REPAIR AND STORM SEWER IMPROVEMENTS.

LEGEND

EXISTING	PROPOSED
8" W	8" W WATER MAIN
8" SS	8" SS SEWER MAIN
42" SS	42" SS SEWER MAIN TO ABANDON
UG/T	UG/T UNDERGROUND TELEPHONE
UG/E	UG/E UNDERGROUND ELECTRIC
OH/E	OH/E OVERHEAD ELECTRIC
GS	GS GAS MAIN
X	X WIRE FENCE
o	o CHAIN LINK FENCE
o	o WOOD FENCE
o	o GAS METER
o	o WATER METER
o	o FIRE HYDRANT
o	o WATER VALVE
o	o AIR RELEASE
o	o MANHOLE
o	o POWER POLE
o	o POWER POLE W/ GUY
o	o CONTROL POINT
o	o FOUND IRON PIN/PIPE
o	o SIGN
o	o PAWING REPAIR

Revisions



Drawn by: CSB	Job Number: JOBNO
Checked by: ABS	Contact Person: TRAVIS TRIPODI

Date: 01/20/2026	Sheet Number: 4
---------------------	--------------------



RWU ROGERS WATER UTILITIES
 P.O. DRAWER 338
 OFFICE - 601 SOUTH 2ND ST. ROGERS, ARKANSAS
 72757-0338

VICINITY MAP
 N.T.S.

2025 LARGE DIAMETER SEWER REHAB

DIVERSION BOX DETAIL


- NOTES:
1. THIS PLAN DOES NOT PROPORT TO SHOW THE LOCATIONS OF ALL UNDERGROUND UTILITIES AS PRECISE OR COMPLETE. THE CONTRACTOR SHALL VERIFY DEPTHS & LOCATIONS OF UNDERGROUND UTILITIES PRIOR TO CONSTRUCTION.
 2. LOCATIONS OF SERVICE CROSSINGS ARE SUBJECT TO FIELD CHANGES BY ROGERS WATER UTILITIES.
 3. THE CONTRACTOR SHALL ADHERE TO ALL RWU STANDARD DETAILS AND SPECIFICATIONS (LATEST EDITION) FOR WORK PERFORMED ON WATER & SEWER UTILITIES.
 4. COORDINATE WITH THE ROGERS STREET DEPT. FOR STREET REPAIR AND STORM SEWER IMPROVEMENTS.

LEGEND	
EXISTING	PROPOSED
8" W	WATER MAIN
8" SS	SEWER MAIN
2" SS	SEWER MAIN TO ABANDON
UG/T	UNDERGROUND TELEPHONE
UG/E	UNDERGROUND ELECTRIC
OH/E	OVERHEAD ELECTRIC
GAS	GAS MAIN
X	WIRE FENCE
o	CHAIN LINK FENCE
□	WOOD FENCE
⊗	GAS METER
⊙	WATER METER
⊕	FIRE HYDRANT
⊖	AIR RELEASE
⊘	MANHOLE
⊙	POWER POLE
⊙	POWER POLE W/ GUY
⊙	CONTROL POINT
⊙	FOUND IRON PIN/PIPE
⊙	SIGN
⊙	PAVING REPAIR


Revisions

Drawn by: CSB	Job Number: JOBNO
Checked by: ABS	Contact Person: TRAVIS TRIPOLI


Date: 01/20/2026	Sheet Number: 6
---------------------	--------------------

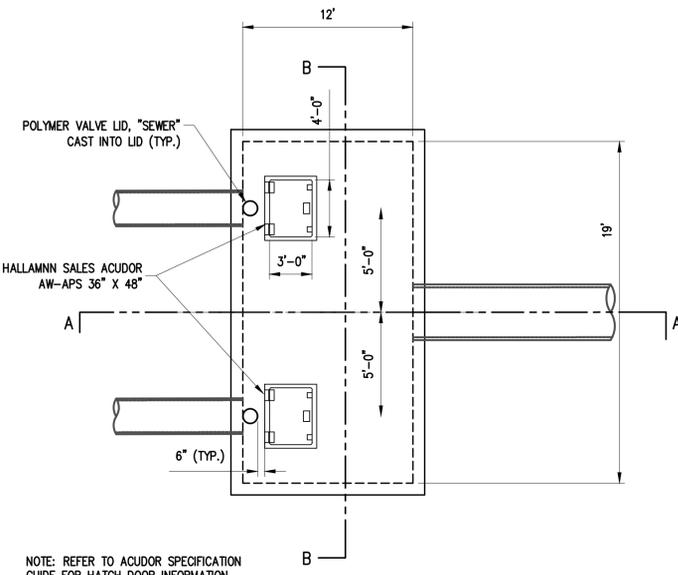

DIVERSION BOX, TOP SLAB NTS

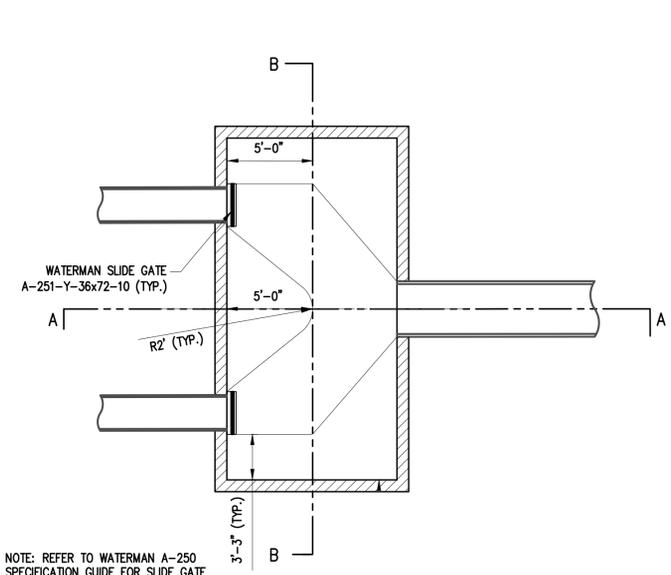


DIVERSION BOX, FLOOR SLAB NTS

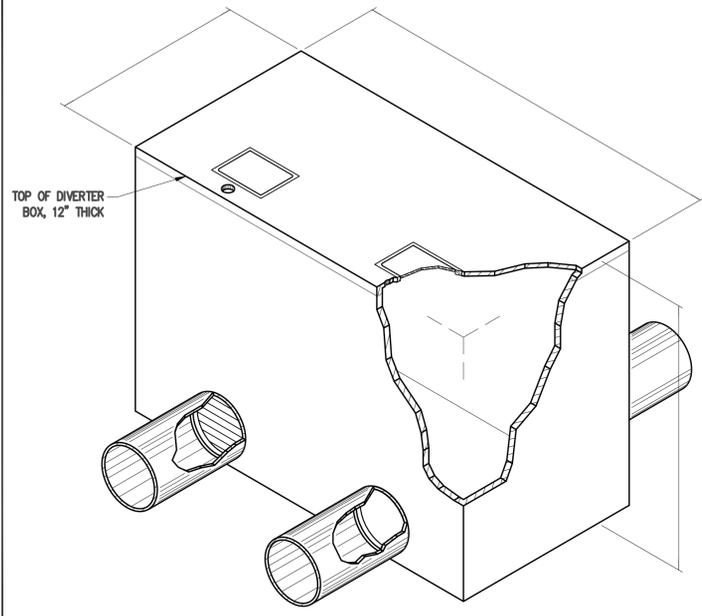


TYPICAL DIVERTER BOX NTS

- NOTES:
1. REFER TO WATERMAN A-250 SPECIFICATION GUIDE FOR SLIDE GATE INFORMATION.
 2. REINFORCING BARS SHALL HAVE 2" MIN. COVER UNLESS OTHERWISE NOTED.
 3. CONCRETE SHALL BE CLASS B, 3500 PSI, WITH 4-7% A.E. AND GRADE 60 REINFORCING BARS.

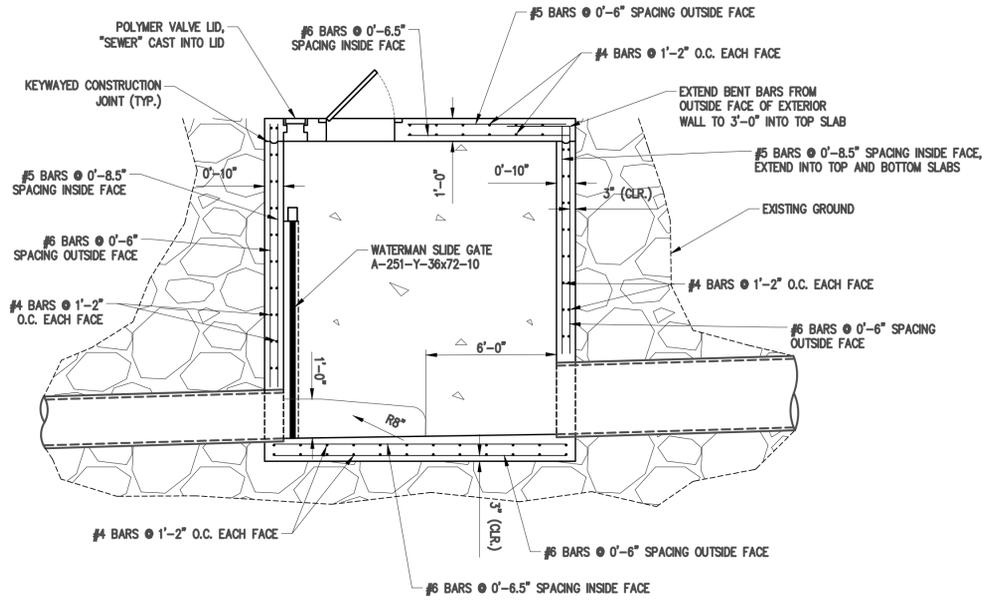

DIVERSION BOX, SECTION A-A, NTS

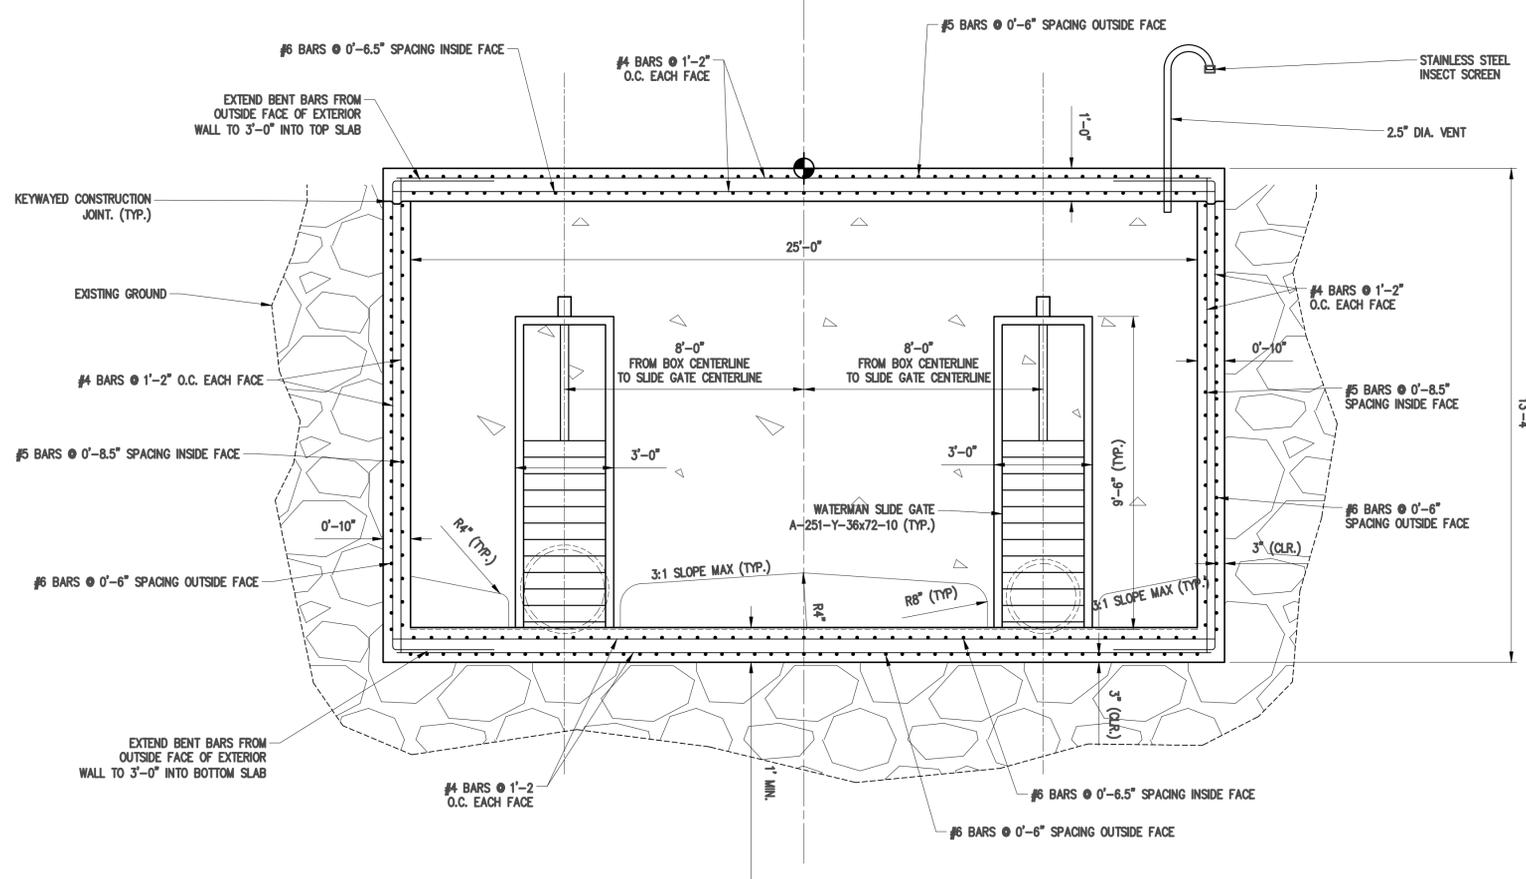

DIVERSION BOX, SECTION B-B, NTS

